


SP. NO.

Yamatake Corporation


製品仕様書
SPECIFICATIONS

ELECTRICAL RATINGS:	Recommended DC Current	7mA
	Maximum Allowable DC Current	10mA
PROTECTORELAY TO BE USED WITH:	R4150, R4780C, WN200A, WN210A, RA890G, FRS100C, RM7800 Series	
WIRING CONNECTIONS:	Connect Terminal F to Terminal F of Protectorelay Connect Terminal G to Terminal G of Protectorelay Conduit Connection G1/2(PF1/2) The blue leadwire must be connected to the F terminal and the white leadwire to the G terminal.	
ALLOWABLE PRESSURE IN FURNACE:	34kPa	
AMBIENT TEMPERATURE:	-20 to +80°C	
MOUNTING:	Applicable thread size of sighting pipe is 1-11BSP (Also G1 and R1 applicable)	
ALLOWABLE VIBRATION LIMIT:	4.9m/s ² 60s ⁻¹	
INSULATION RESISTANCE:	Should be more than 50 megohms at DC500V megger between each terminal, and between each terminal and metal part of socket. (with tube removed)	
DIELECTRIC STRENGTH:	Should be capable of withstanding a potential of AC1500V 50 or 60Hz for 1 minute between each terminal and metal part of socket. (with tube removed)	
TERMINAL BOX MATERIAL:	Duranex	

The effective operation term of the UV tube is three-year progress after the inspection date of our company, or aggregate use 25000 hours. For safety purposes, be sure to replace the UV tube within this term.

					作成 DR. H. Sato May. 21. '85		尺度 SCALE ~	記入のない公差 TOL. UNLESS NOTED ~			
	05	JEO03-0327	4.17.'03	S. Nakanishi	S. Miura	検図 CHK. M. Imano May. 21. '85	形番 MODEL	C7035A500J			
	04	JEO97-0185	3-22-'97	Harada	Yamada	認可 APPD	名称 NAME	ULTRAVISION			
2	05	02	Redrawn	5.8.'85	M.I	H.Sato	日付 DATE 4.17.'03	図番 NO.	AD1355E	改番 REV. 05	1/2
頁	改番	改番 REV.	来歴 RECORD	日付 DATE	担当 BY	検閱 APPD.					

SP. No.

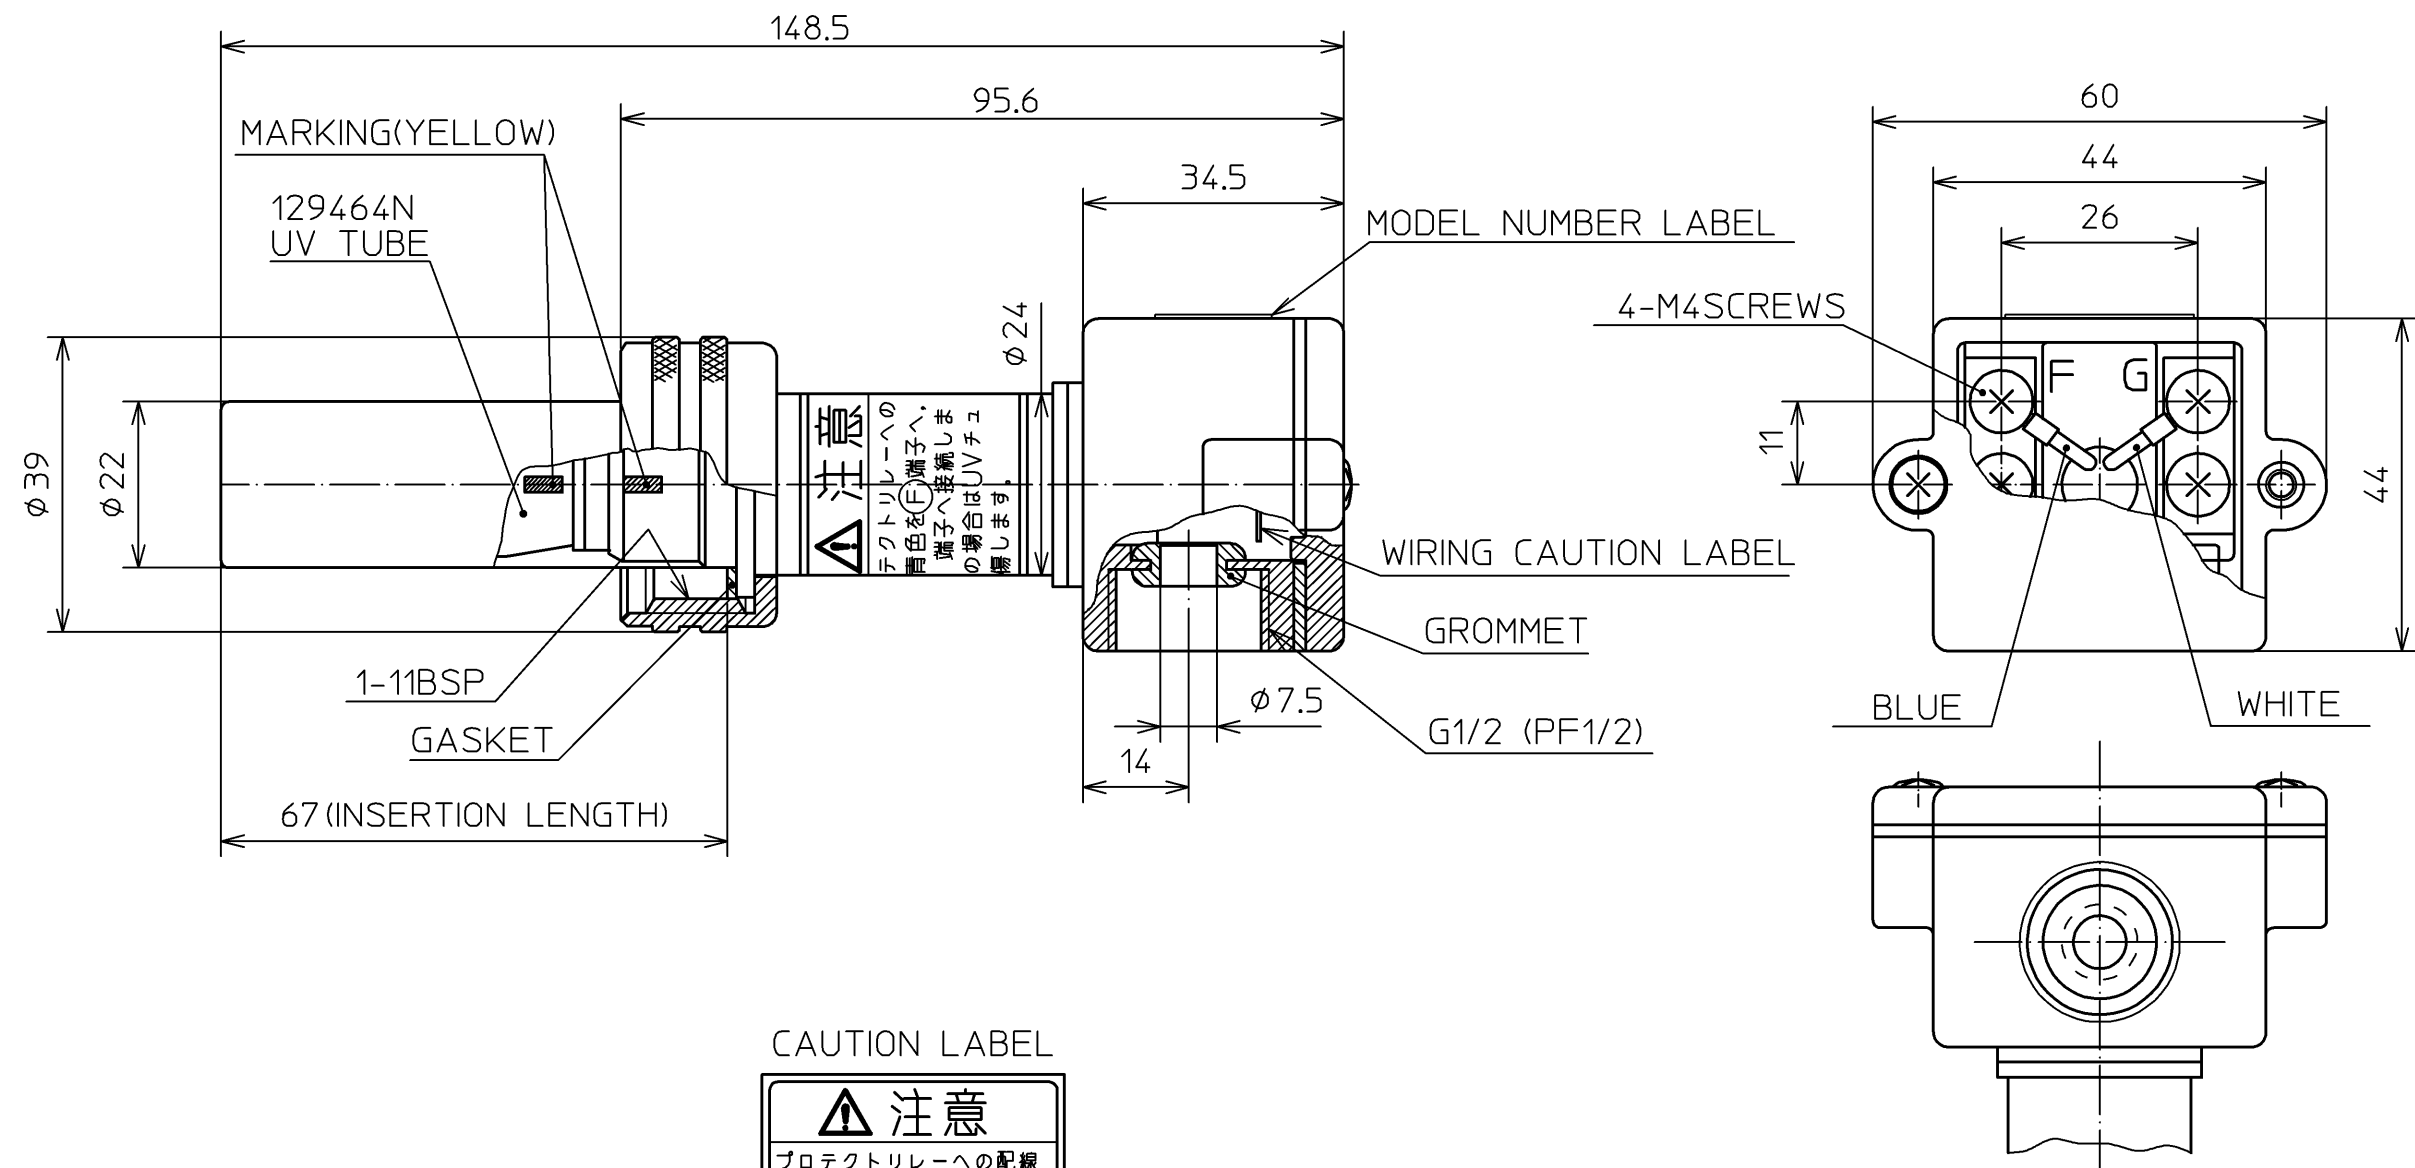

CAUTION LABEL

注意

プロテクトリレーへの配線は、青色を(F)端子へ、白色を(G)端子へ接続します。逆接続の場合はUVチューブを損傷します。

作成DR. A.Sato 2.18.'85	検図CHK. M.Ogido 2.20.'85	認可APPD K.Murata 3.22.'85	日付DATE 4.17.'03	来歴 RECORD	日付 DATE	担当 BY	検閲 APPD.	尺度SCALE 1:1	記入のない公差 TOL. UNLESS NOTED	形番 MODEL C7035A500J	名称 NAME ULTRAVISION	図番 NO. AD1355E	改番REV. 05	2/2
05	JE003-0327	4.17.'03	S.Nakanishi	S.Miura										
04	JE097-0185	3.25.'97	S.Miura	M.Ogido										
03	ADD TO MARKING(YELLOW)	11.5.'93	NKURIYAMA	S.Miura										
2	REDRAWN	2.18.'85	A.S	M.O										

SP.NO.

Yamatake Corporation

製品仕様書
SPECIFICATIONS

“RESTRICTIONS ON USE”

This product has been designed, developed and manufactured for general-purpose application in machinery and equipment.

Accordingly, when used in applications outlined below, special care should be taken to implement a fail-safe and/or redundant design concept as well as a periodic maintenance program.

- Safety devices for plant worker protection
- Start/stop control devices for transportation and material handling machines
- Aeronautical/aerospace machines
- Control devices for nuclear reactors

Never use this product in applications where human safety may be put at risk.

1	00	00	First issue	12-2-02	Harada	Miura
頁	改番	改番	来歴	日付	担当	検閲
	REV.	REV.	RECORD	DATE	BY	APPD.